


# Glass and Glazing

## IDENTIFICATION

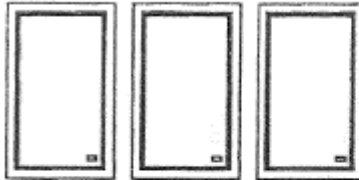

EACH LIGHT SHALL BEAR THE MANUFACTURER'S LABEL DESIGNATING THE TYPE AND THICKNESS OF GLASS.

WHEN APPROVED BY THE BUILDING OFFICIAL, LABELS MAY BE OMITTED, PROVIDED AN AFFIDAVIT IS FURNISHED BY THE GLAZING CONTRACTOR.

## GLASS AND GLAZING SECTION 2402

---

## AREA LIMITATIONS

THE AREA OF INDIVIDUAL LIGHTS SHALL NOT BE MORE THAN AS SET FORTH IN GRAPH 24-1, AS ADJUSTED BY TABLE 24-1.

DESIGN WIND PRESSURE  
FROM SECTION 2311

=

DESIGN PRESSURE TO BE USED  
WITH GRAPH 24-1

ADJUSTMENT FACTOR  
PER TABLE 24-1

WHEN APPROVED BY THE BUILDING OFFICIAL, ALTERNATE MEANS FOR SELECTING GLASS MAY BE USED IN PLACE OF GRAPH NO. 54-1 AND TABLE 24-1.


## GLASS AND GLAZING SECTION 2403

---


## SAFETY GLAZING IDENTIFICATION

EACH LIGHT OF SAFETY GLAZING MATERIAL INSTALLED IN HAZARDOUS LOCATIONS AS DEFINED IN SECTION 2406.4 SHALL BE IDENTIFIED BY A LABEL WHICH WILL:

- SPECIFY THE LABELER, AND
- STATE THAT SAFETY GLAZING MATERIAL HAS BEEN UTILIZED IN THE INSTALLATION.

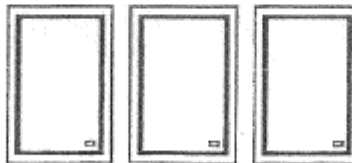

- EACH UNIT OF TEMPERED GLASS SHALL BE PERMANENTLY IDENTIFIED BY THE MANUFACTURER.
- THE IDENTIFICATION SHALL BE ETCHED OR CERAMIC FIRED ON THE GLASS AND BE VISIBLE WHEN THE UNIT IS GLAZED.
- TEMPERED SPANDREL GLASS IS EXEMPTED FROM PERMANENT IDENTIFICATION.

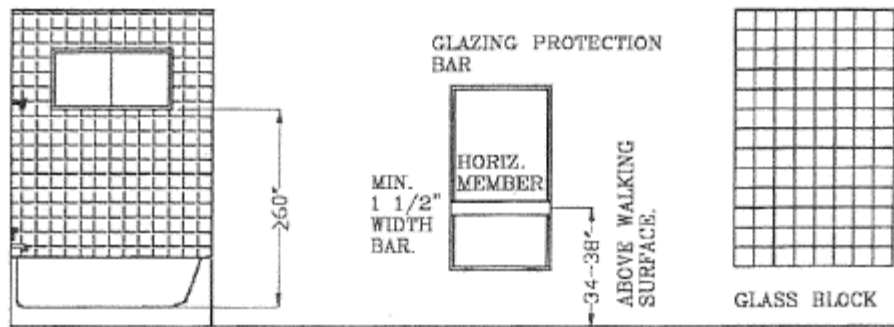

ITEM 5

BAR CAPABLE OF  
RESISTING  
50 pcf LOAD.


MUST COMPLY WITH  
Sec. 2407(1)5.

## SAFETY GLAZING HAZARDOUS LOCATIONS Section 2406 Exception


### EXEMPTIONS FROM HAZARDOUS LOCATIONS

THE FOLLOWING PRODUCTS, AND APPLICATIONS ARE EXEMPT FROM THOSE HAZARDOUS LOCATIONS SPECIFIED IN SECTION 2406.4(1-8):


- OPENINGS IN DOORS THROUGH WHICH A 3-INCH SPHERE IS UNABLE TO PASS.
- ASSEMBLIES OF LEADED GLASS, FACETED GLASS AND CARVED GLASS WHEN USED FOR DECORATION.
- GLAZING MATERIALS USED AS CURVED GLAZED PANELS IN REVOLVING DOORS.
- COMMERCIAL REFRIGERATED CABINET GLAZED DOORS.
- GLASS BLOCK PANELS COMPLYING WITH 2407 (1) 5.
- GLASS BLOCK COMPLYING WITH SECTION 2109.5.




INGRESS & EGRESS  
DOORS



GLASS DOORS  
FRAMED & UNFRAMED




STORM DOORS

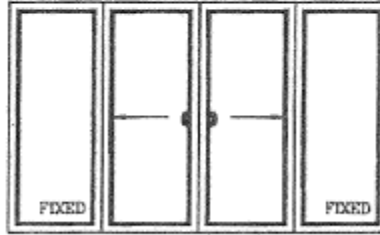


SLIDING-TYPE DOORS


HAZARDOUS LOCATIONS,  
DOORS WITH GLAZING  
Section 2406.4 (1-4)



WARDROBE DOORS  
SUBSECTION (E)




TUB  
ENCLOSURE





SHOWER  
ENCLOSURE

HAZARDOUS LOCATIONS,  
DOORS WITH GLAZING  
Section 2406.4 (5)

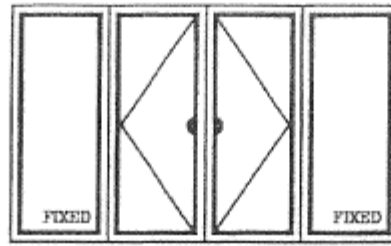


DOUBLE ENTRY DOOR WITH SIDELIGHTS

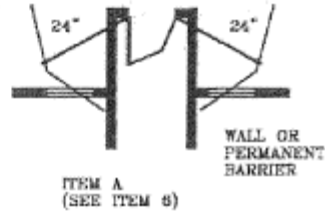

HAZARDOUS LOCATIONS  
DOORS WITH GLAZING  
Section 2406.4 (6)

GLAZING IN FIXED PANELS OTHER THAN THOSE COVERED BY SECTION 2408.4, ITEMS 5 AND 6 SHALL COMPLY AS FOLLOWS:

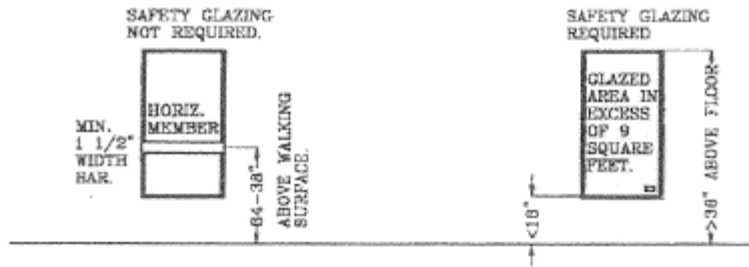

HAZARDOUS LOCATIONS  
GLAZED PANEL  
Section 2406.4 (7) & Exception